



60 AMP CIRCUIT BREAKER DISCONNECT
 CB1 230 UAC 3PH 60hz

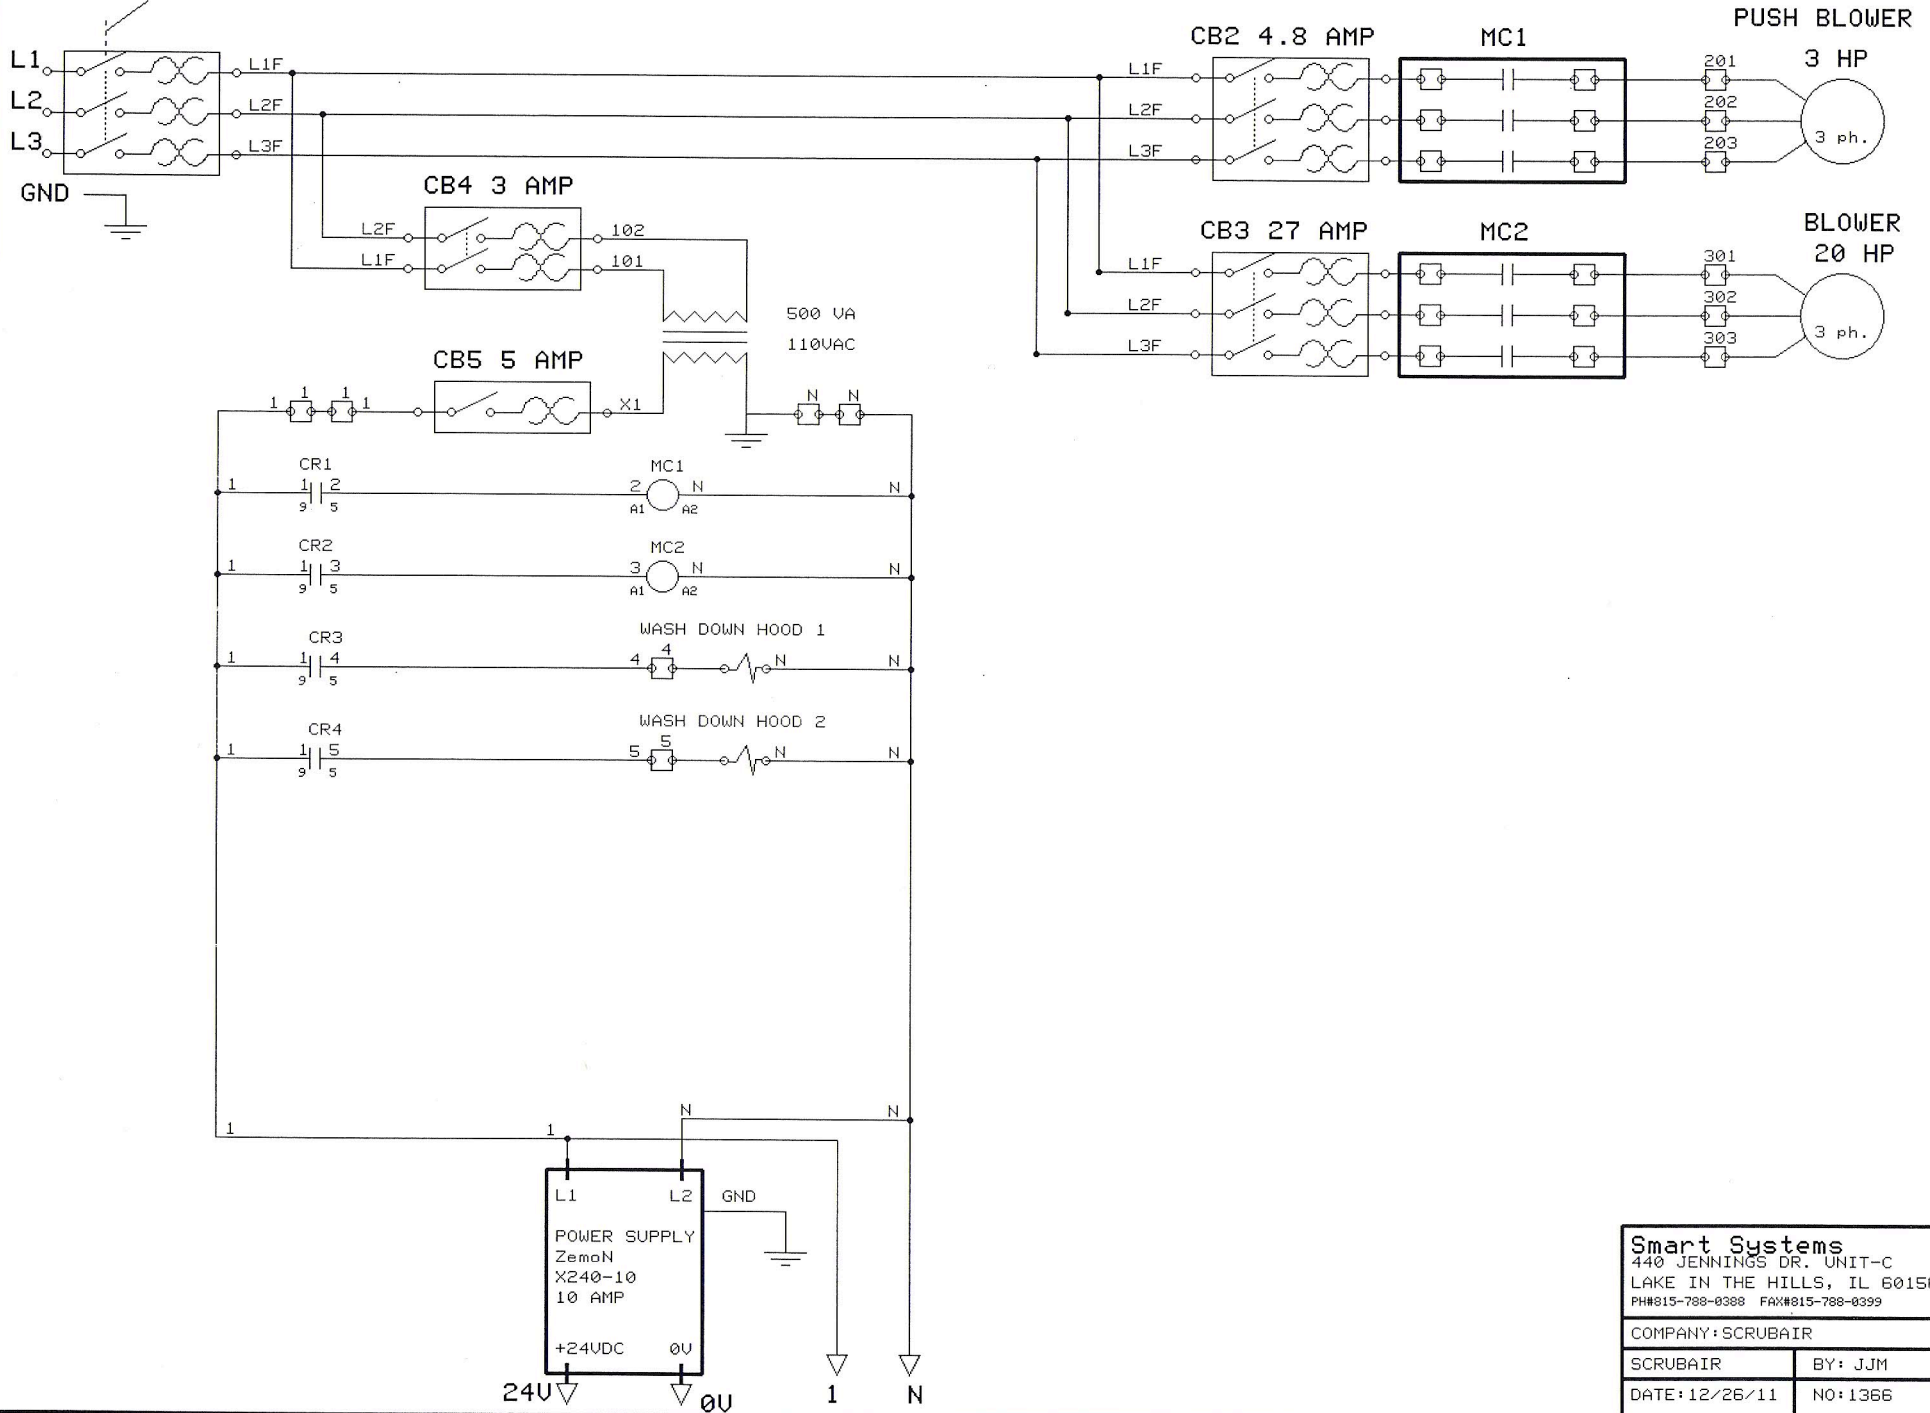

Smart Systems
 440 JENNINGS DR. UNIT-C
 LAKE IN THE HILLS, IL 60156
 PH#815-788-0388 FAX#815-788-0399

COMPANY: SCRUBAIR	
SCRUBAIR	BY: JJM
DATE: 12/26/11	NO: 1366

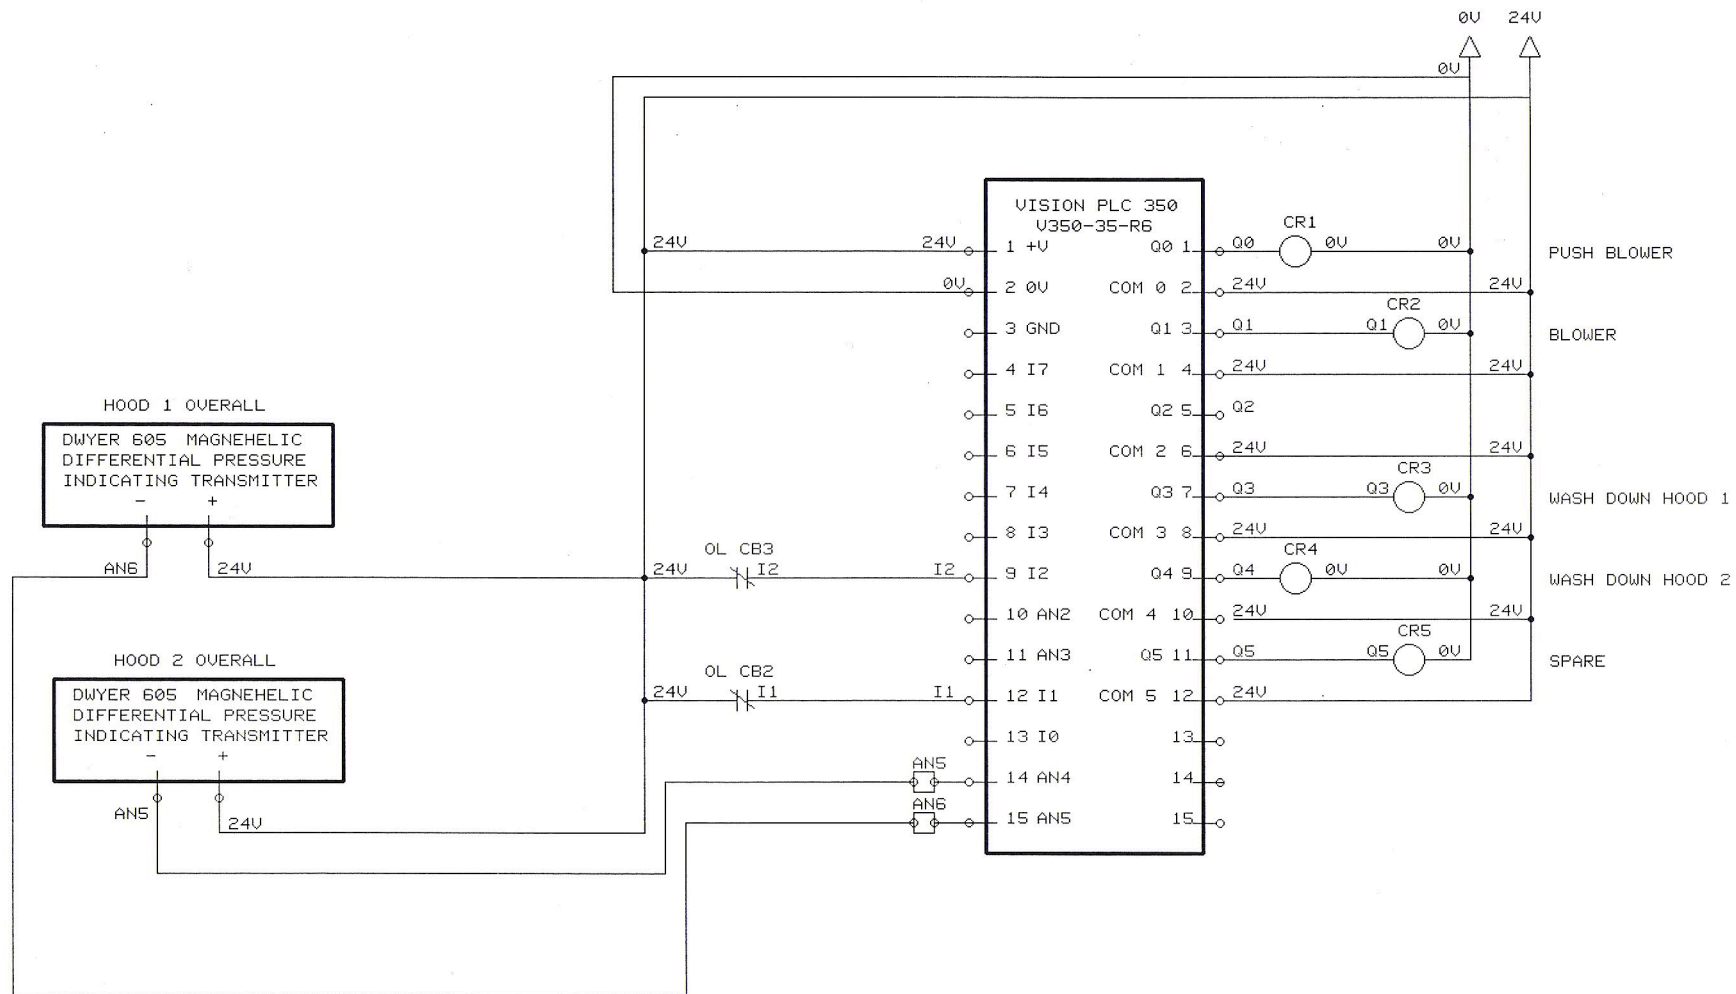

Smart Systems
 440 JENNINGS DR. UNIT-C
 LAKE IN THE HILLS, IL 60156
 PH#815-788-0388 FAX#815-788-0399

COMPANY: SCRUBAIR	
SCRUBAIR	BY: JJM
DATE: 12/26/11	NO: 1366A